



229 Highway 51 - PO Box 715


Postville, IA 52162-0715

Phone: (563) 864-7611 - (888) 788-1551

Email: acrec@acrec.coop

Website: www.acrec.com

Submeter Installation

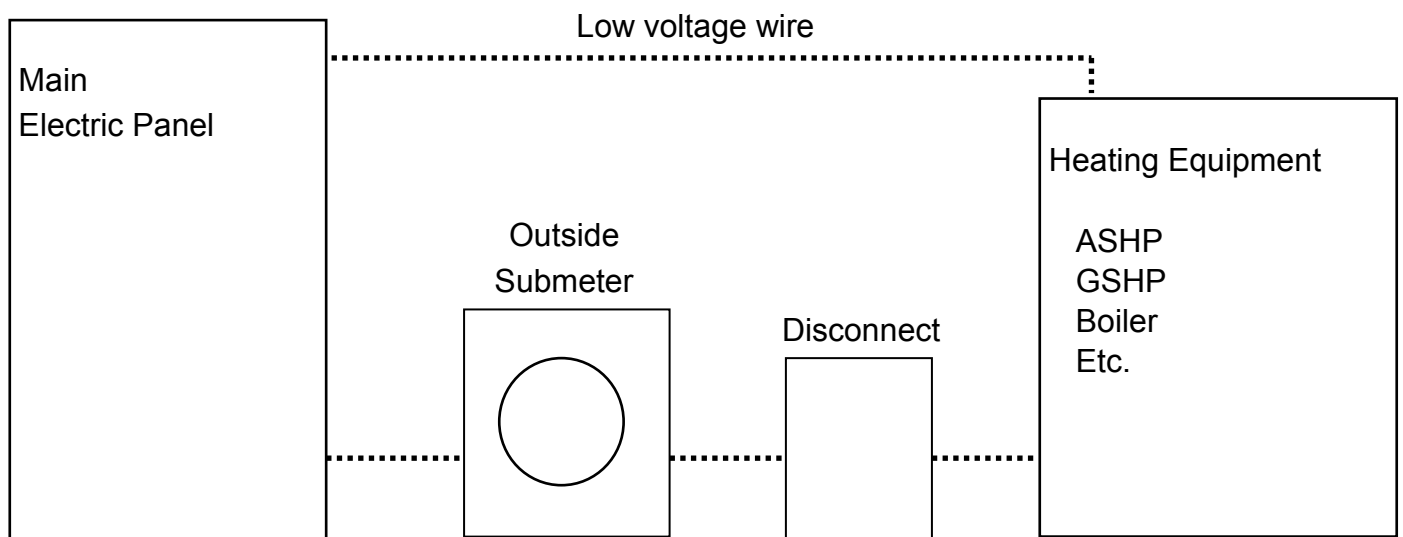

- 1) All submeter installations must be approved by Allamakee-Clayton Electric Co-op.
- 2) A disconnecting means is required between the submeter and heating equipment if there is not one on the equipment. Disconnect mounted inside for homeowner use.
- 3) All submeter installations must be inspected and released by local inspections department PRIOR TO METER INSTALLATION.
- 4) Low voltage wire "required" to be N/C loop that shuts down the unit, but still maintains the backup. Cooperative needs 4' N/C loop at the panel.
- 5) **Please ensure that all submeters are grounded and neutral and ground are not re-bonded.**