

ALLAMAKEE-CLAYTON ELECTRIC COOPERATIVE, INC.

Wiring Specifications and Recommendations

Phone: 563-864-7611 or 1-888-788-1551

Underground Service Specifications

1 Phase 120/240 Volt - 200/320 Amp


- Meter socket to be provided and installed by the wireman 4' to 6' above final grade.
- Line side conductor is the responsibility of the ACEC and will be installed by line personnel.
- Line and load side conduit and fittings plus load side conductor are the responsibility of the wireman.
- Wireman to provide line side lugs on 320 Amp sockets.
- Line side conduit must be Sch. 80 PVC.
- Expansion Joint required.

PLEASE NOTE:

All trenching is the responsibility of Allamakee-Clayton Electric Cooperative and will be arranged by them. Joint use of the trench is permitted with prior approval, with the exception of water and sewer systems.

ACEC will not install its conductor until landscaping is within 6" of final grade.

Left side of meter is only for utility

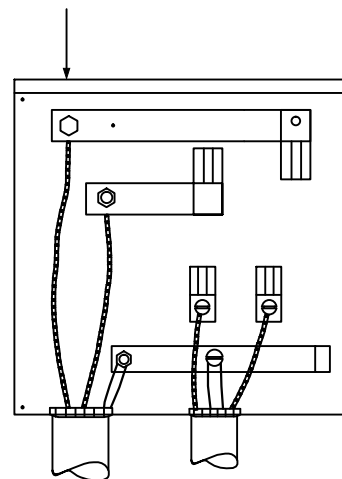

Utility Enter Left side only

